



Rechargeable Li-ion Battery

RV12100 User Manual

Information Version: 1.0

20RVSV0802

This manual introduces RV12100 from Pylontech. Please read this manual before you to install the battery and follow the instruction carefully during the installation process. Any confusion, please contact Pylontech immediately for advice and clarification.

Table of Contents

1.	Introduction	2
	1.1 Product features	2
	1.2 Product appearance	2
	1.3 Scope & purpose of application	3
2.	Product Parameters	3
	2.1 Battery module technical parameters	3
	2.2 Panel definitions	4
	2.3 System wiring	6
3.	Installation Environment	7
4.	Transportation & Storage	8
	4.1 Transportation requirements	8
	4.2 Storage requirements	8

1. Introduction

1.1 Product Features

The lithium iron phosphate battery adopts the modular series design, through the reliable BMS system and high-performance equalization technology, the whole system has the characteristics of flexible configuration and high reliability.

- Voltage platform: 12V;
- High C rate: the output power reaches sustained 1C;
- High safety: lithium iron phosphate battery is safe and reliable
- High reliability: interactive cooperative guarantee mechanism is adopted to improve system reliability;
- Minimalist design: bolt design of positive and negative terminals with strong adaptability
- Battery status information display, SOC display;
- Ultra-long cycle life: 4000 cycles

1.2 Product Appearance



1.3 Scope & Purpose of Applications

This battery is mainly used for RV, Caravan and similar recreational vehicle usage.

It is designed to replace traditional lead acid battery types

12V battery applications also include Electric vehicles & marine use

2. Product Parameters

2.1 Battery Module Technical parameters

No.	Item	Value
1	Nominal capacity	100 Ah
2	Nominal voltage	12.8Vdc
3	Voltage range	10 ~14.8 Vdc
4	Recommend charge voltage	10 ~14.4 Vdc
5	Continuous charging current	DC 50A
6	Continuous discharging current	100A
7	Working temperature	-20°C~50°C
8	Humidity	5~95%
9	Cooling	Natural cooling
10	Dimension	300mm x 173mm x 220mm
11	Weight	≤15kg
12	IP rate	IP20
13	Communication	Optional
14	Parallel Connection	Support

2.2 Panel Definitions



Battery switch:

Press the Power Button for 1 second, the LEDs indicating health will light up and 1 second later the battery output will be active.

Press the Power Button for 3 seconds to turn off the battery. Turning the battery back on is locked out for 3 seconds.

Self-check lamp status :

When the initial self-check is completed, all lights will be turn on for a while and then return to the normal display state.

Please refer to the table below for normal display state :

State	Soc	Status		SOC				Remark
		●★ Run	●★ ALM	SOC4	SOC3	SOC2	SOC1	
Turn off								All off
Idle	0% 25%						●	All SOC Light is solid
	26%-50%	●				●	●	
	51%-75%				●	●	●	
	76%-100%			●	●	●	●	
Charge	0%-25%						★	The SOC top one is flashing, others are solid
	26%-50%	●				★	●	
	51%-75%				★	●	●	
	76%-100%			★	●	●	●	
discharge	100%-76%			●	●	●	●	The Run light is flashing
	75%-51%	★			●	●	●	
	50%-26%					●	●	
	25%-0%						●	
Alarm	Alarm		★	According to SOC state				Automatically eliminated when value back to normal level
Protect	Protect	●						Battery shutdown until value back to normal level


Indicator light description:

- : Blue light solid
- ★: Blue light flashing (2S flashing)
- : Red light solid
- ★: Red light flashing (2S flashing)

2.3 System Wiring

2.3.1. Parallel Connection:

Before wiring the battery model, make sure all batteries are turned off. Follow the steps shown below for wiring, with all positive poles together and all negative poles together. Then press any battery's Power button and the other batteries will turn on automatically.

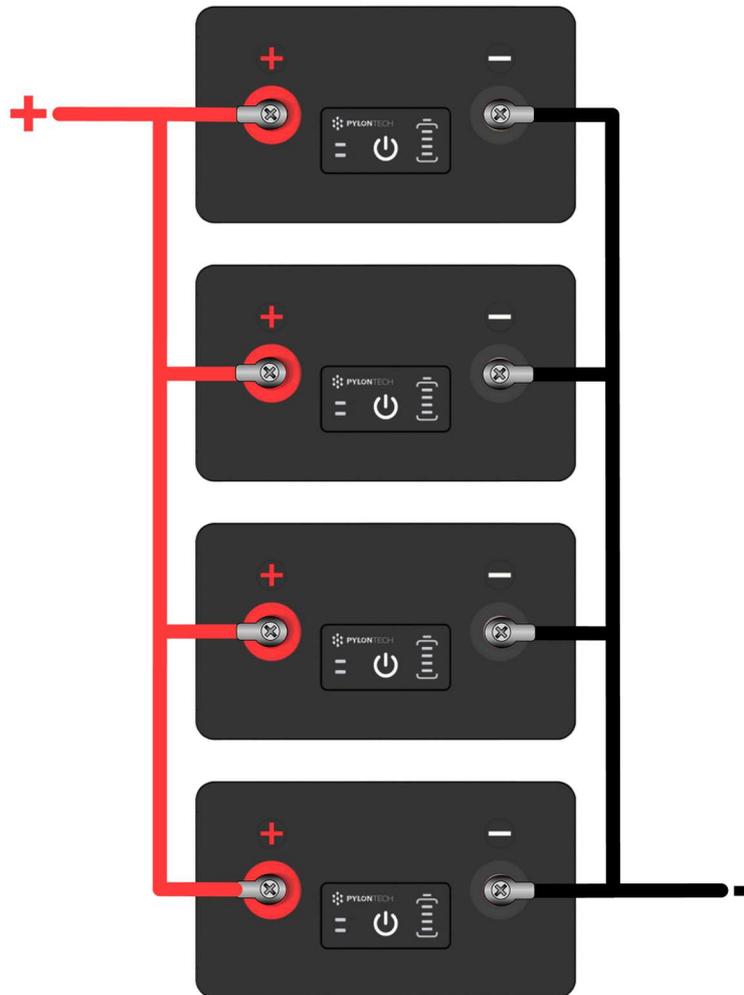


Please Note:

1. The number of Parallel connections is limited to 8 pieces
2. Ensure that the voltage difference between the batteries should not exceed 0.2V before connection. If batteries do exceed 0.2V difference then all batteries will require a full charge so they are an equal voltage.
3. Each set of the battery external cables should have the same wire diameter and length. This keeps the current flow of each battery consistent during operation.
4. When 2~8 batteries are connected in parallel, the charge-discharge current shall not exceed 0.5C of the total bank capacity.

2.3.2. Series Connection:

Before wiring the battery model, make sure all batteries are turned off. Follow the steps shown below for wiring. Then press any battery's Power button one by one.

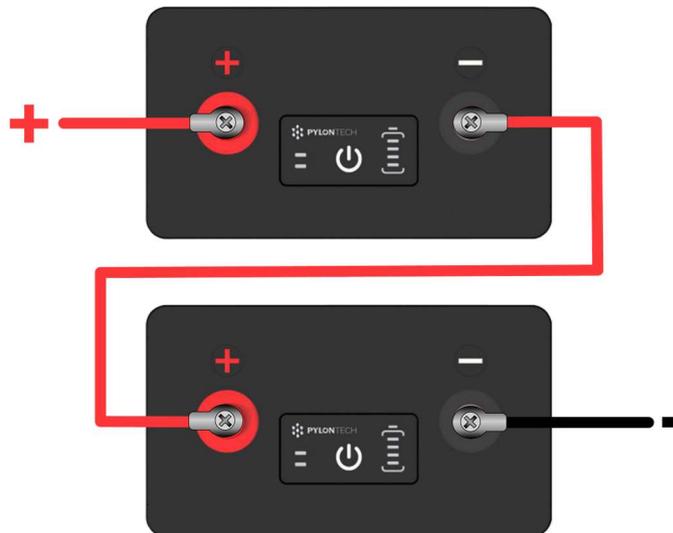

Please Note:

1. The maximum number of series connections is limited to 2 pcs - 24V.
2. Each battery should have the same capacity and the same voltage. Otherwise it will affect subsequent use
3. Ensure that the voltage difference between the batteries should not exceed 0.2V before connection. If batteries do exceed 0.2V difference then all batteries will require a full charge so they are an equal voltage.
4. Connect all batteries in parallel (considering point 3 above) for 12-24 hours so that batteries are equalized before connecting in series
5. If one battery goes into protective mode, the whole system will shut down

3. Installation Environment

Battery operating environment requirements are as follows:

Working temperature: 0°C - 50°C

Humidity: 5% - 95%

Altitude: <4000m

The site environment: Away from heat, no corrosive gas, no explosive gas, no damaging gas, no damaging insulation Conductive dust

4. **Transportation & Storage**

4.1 **Product Transportation requirements**

Prevent violent vibration, impact or extrusion,

Do not expose to sun or rain,

In the process of loading and unloading, the battery should be handled gently to prevent throwing, rolling and weight.

4.2 **Product Storage requirements**

Batteries should be stored in clean, dry and ventilated rooms where the ambient temperature is $-20^{\circ}\text{C} \sim 60^{\circ}\text{C}$ and the relative humidity is no more than 85%.

Battery should avoid contact with corrosive substances, should be far away from the source of fire and heat.

Battery storage SOC: 40% ~ 50%.

Long-term storage: before storage, the SOC should be more than 80%, and the battery should be periodically recharged every six months to the 80% SOC.

*Our products come with guarantees that cannot be excluded under the Australian Consumer Law. You are entitled to a replacement or refund for a major failure and for compensation for any other reasonably foreseeable loss or damage. You are also entitled to have the goods repaired or replaced if the goods fail to be of acceptable quality and the failure does not amount to a major failure. The benefits under this warranty are in addition to other rights you may have at law.

The warranty against defects is provided by the import agent Master Instruments Pty Ltd: 13 Sheridan Close Milperra NSW 2214.